


# TNRD MANUFACTURED HOME BLOCKING SCHEDULE MUST CONFORM TO MANUFACTURER'S SPECIFICATIONS AND CAN/CSA Z240.10.1


## MANUFACTURED FOUNDATION SPECIFICATIONS TO BE SUBMITTED

Notes:

- (1) CAN/CGSB 51.34 Ground cover must run beneath the unit and to extend at least 150 mm (6 in) past the sides of the mobile home.
  - (2) Backfill base and ground cover must be graded from the centre to outside with a minimum slope of 2%.
  - (3) Surrounding finished grade must slope away from home.
1. Mobile Home must be skirted and vented
    - Minimum 20" x 28" access door to be located adjacent to services.
  2. Building drain must be ABS.
    - Building drain must have cleanout where the building sewer exits the perimeter wall.
    - Sewer/drain connection by mechanical joint is recommended.
  3. Water service to be minimum 3/4"
    - Stop and drain required on water service. (See handout)
    - Galvanized pipe and fittings not permitted on a potable water system.
  4. Appliances and clothes dryer shall not be vented into the crawl-space.

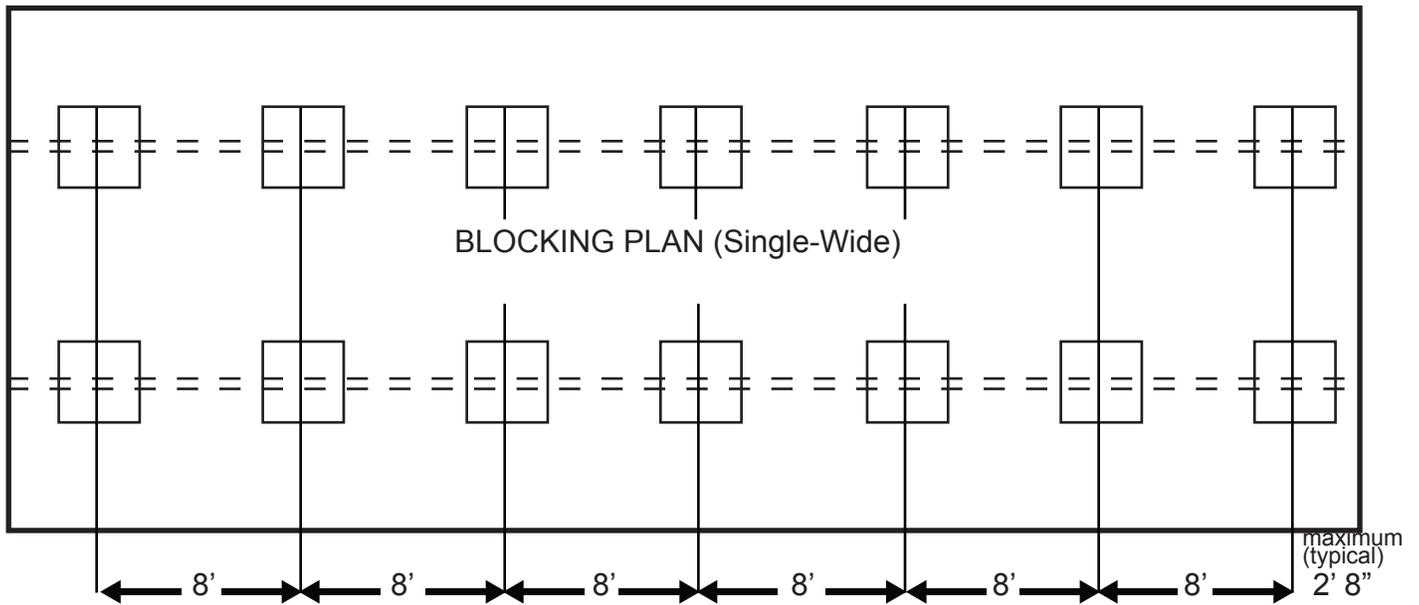


**Engineering is required for the foundation system and anchorage when blocking height exceeds three (3) blocks high**

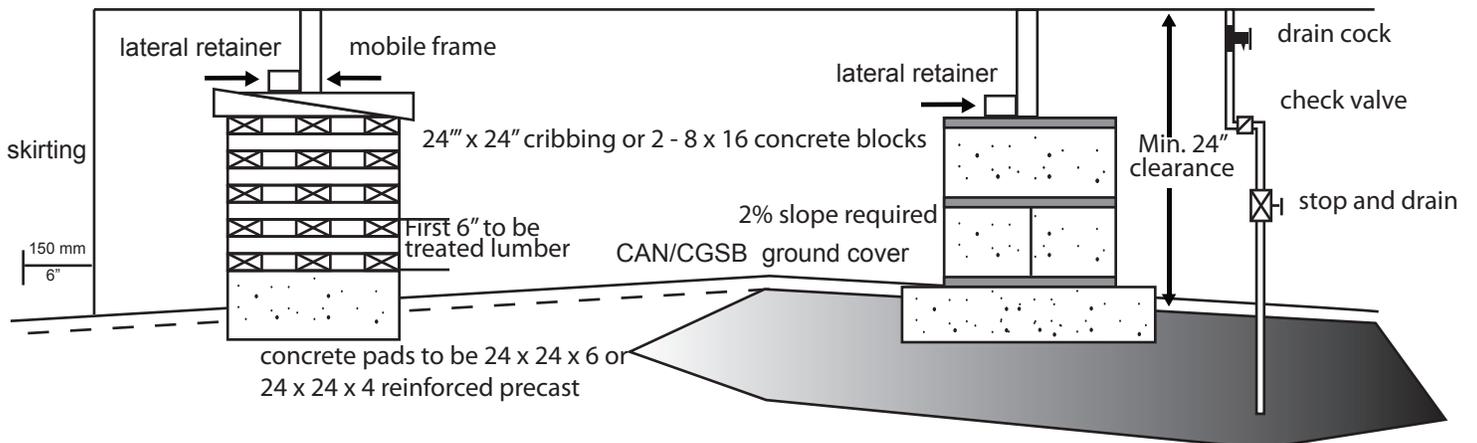

# TNRD DESIGN FOR 2 SQUARE METERS (21 SQUARE FEET) LANDING ONLY

1. Guards are required on stairs and landings where the difference in elevation between adjacent ground level and the top of the stairs or landing exceeds 24".
2. Slip resistant finish is required on exterior stairs and landings.
3. Minimum width of stairs to be 36" and landings to be 36" x 36".

The following diagram is for stairs and landings serving a CAN/CSA Z240 approved Manufactured Home.

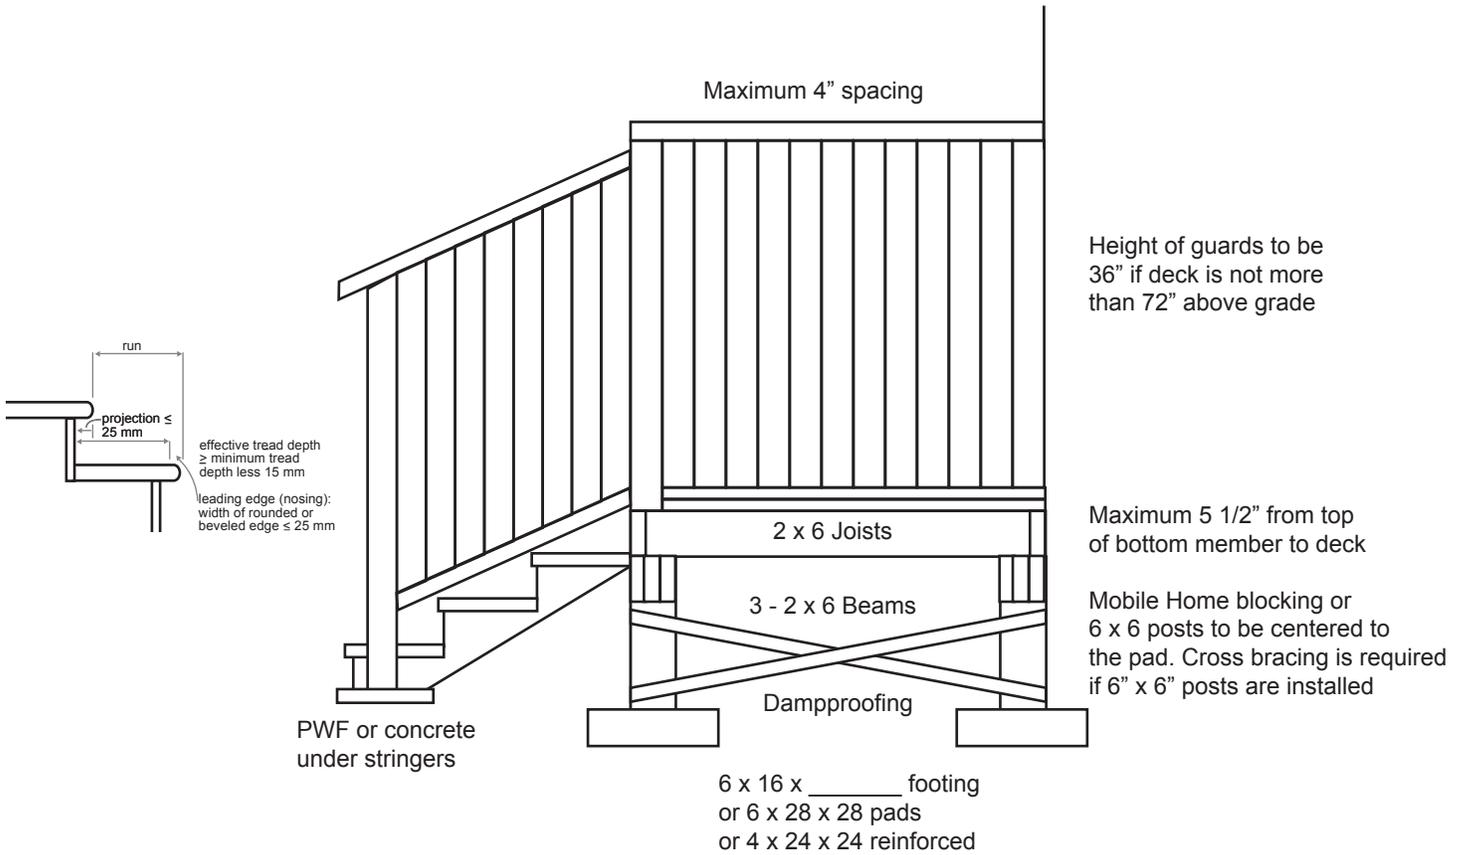

4.	Risers	Maximum	7 7/8"	Minimum	5"
	Run	Maximum	14"	Minimum	8 9/16"
	Tread	Maximum	14"	Minimum	9 1/4"

Risers shall be of uniform height in any one flight  
Treads shall have a uniform run and tread depth